

Population, including environs 37,000. Prevailing Winds, No. West.

KEY

For point of interest
on building
Brick building with
stone base
Stone base
Brick special
with frame side
Frame building
Steel case
special
Frame building
Half 1st or 2nd story
with steel case
Fire no. 5 inches above roof
12
18
24
Opening in ground wall
with steel case
Standard steel case
Windows with iron shutters
Window opening in first story
second
24 3/4 stories
24 1/2
Stable
Horizontal steam boiler
vertical
Stack chimney
Hydrant
Elevators
Fire alarm box
Automatic sprinklers
Automatic fire alarm
Reference to adjoining sheet
I.E.P. independent electric plant

27

WATER FACILITIES
Water supplied by private company which also supplies Waterbury and many towns surrounding boroughs in case of fire fire engine system can be connected. Gravity system of water works. Water supply from Spring Brook. Distribution from four reservoirs having a combined capacity of 1,352,650,000 gallons, and giving a pressure from 70 lbs. to 100 lbs. per sq. inch on Main St.

12 hydrants on Main St. 4 in West Pittston, 13 in Exeter, 4 in Hughestown and one at Intention system was installed in 1933 and water pipes have since been extended and repaired gradually as growth of town required.

In case of necessity water can be pumped from Susquehanna River by Jewell pump-capacity 75 million gallons and one fifty pump capacity 3 million gallons per 24 hours. When so taken it is pumped through filters.

FIRE DEPARTMENT
PITTSBURGH - Two paid drivers, 24 partly paid men, 80 volunteers. Six men sleep in stations, 4 horses, two of which are always at station, the other two used for trucking. Gannett fire alarm, 20 boxes. One fifty second class and one Sutton third class steam fire engine. Two hose wagons, 3500 ft. 2 1/2 hose, four Underwriters extinguishers.


WEST PITTSBURGH - Two paid drivers, 120 volunteers. Four horses employed during the day for trucking. Gannett fire alarm system, 11 boxes. One second class LaFrance steam fire engine. One hose wagon, 2500 ft. of hose.

HUGHESTOWN BORO - 35 volunteers. One hose cart, 1200 ft. of hose.

EXETER - 68 volunteers. Two hose carts, and 2000 ft. of hose, kept in two stations, one of which is near Brewery about three miles N.W. of Pittston Post Office.

Main St is paved with brick in business district and is now being paved to North limit. Broad, William and Water Sts are also paved with brick. Most of West Pittston streets are macadamized; the remaining territory is mostly unpaved graded. West side of river are practically level, those on East side are as shown on detail sheets. Streets mostly lighted by electricity.

No fire limits but frame structures are not allowed to be built in the business district on Main St.

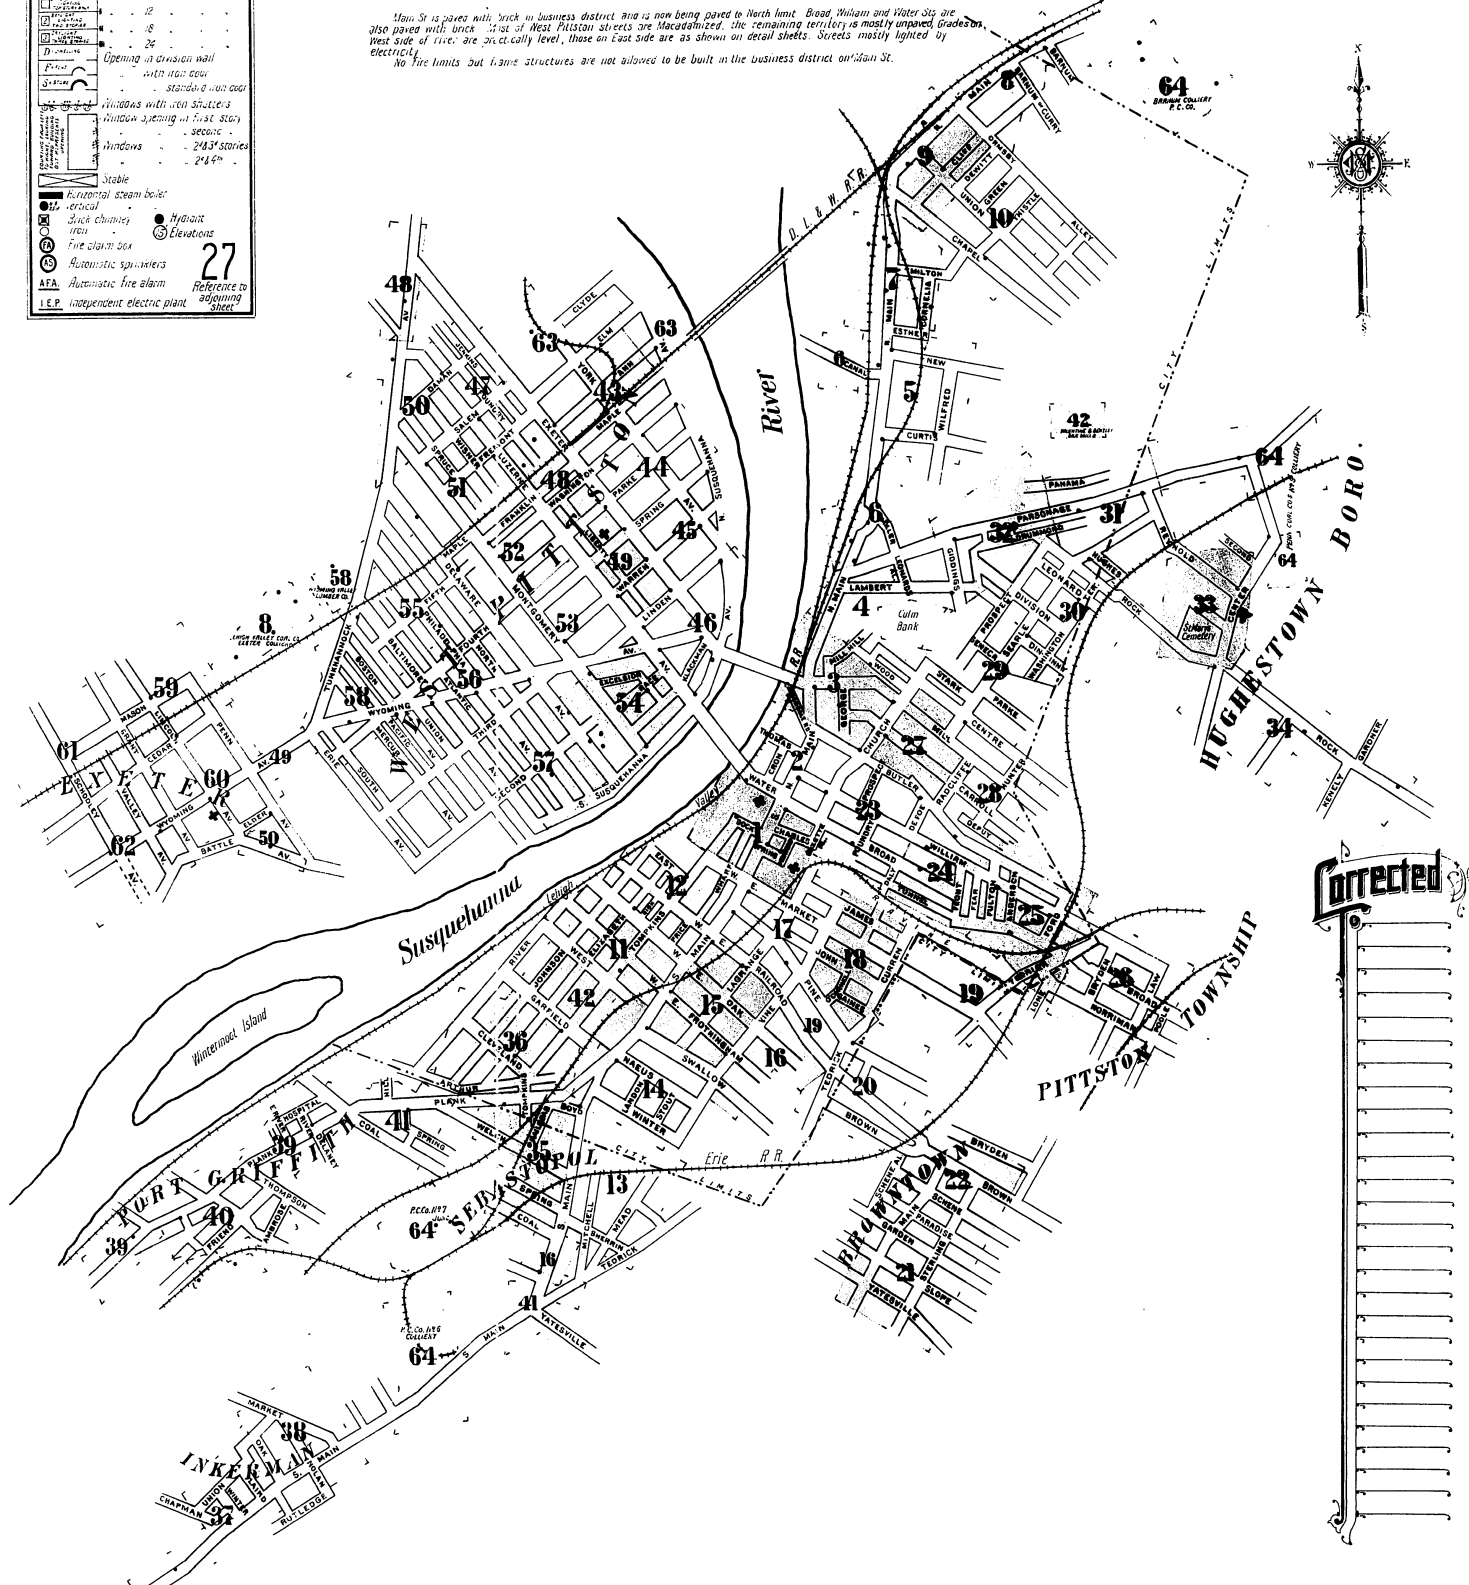

Corrected