





LEHIGH VALLEY COAL CO.
SENECA COLLIERY

HIGH WATERMARK IN COLLYERY
PUMP ROOM NEAR STAIRS
FIRE ESCAPE FROM ELEVATOR
AT LEVEL OF STAIRS ONLY
ON PREMISES HOSE CARR
& 2" DISCHARGE EXHAUSTERS
FOR FIRE BURY CITY WATER
FROM CONNECTION TO
1000' G.P. IN HO. SHEDDING
(CONNECTION IN HO. COLLIERY)
SOURCE OF WATER IS PUMP
IN BREAKER HO.



JEFFERSON SCHOOL
WENTZEL, FARMER
& BANGS, PRINC.

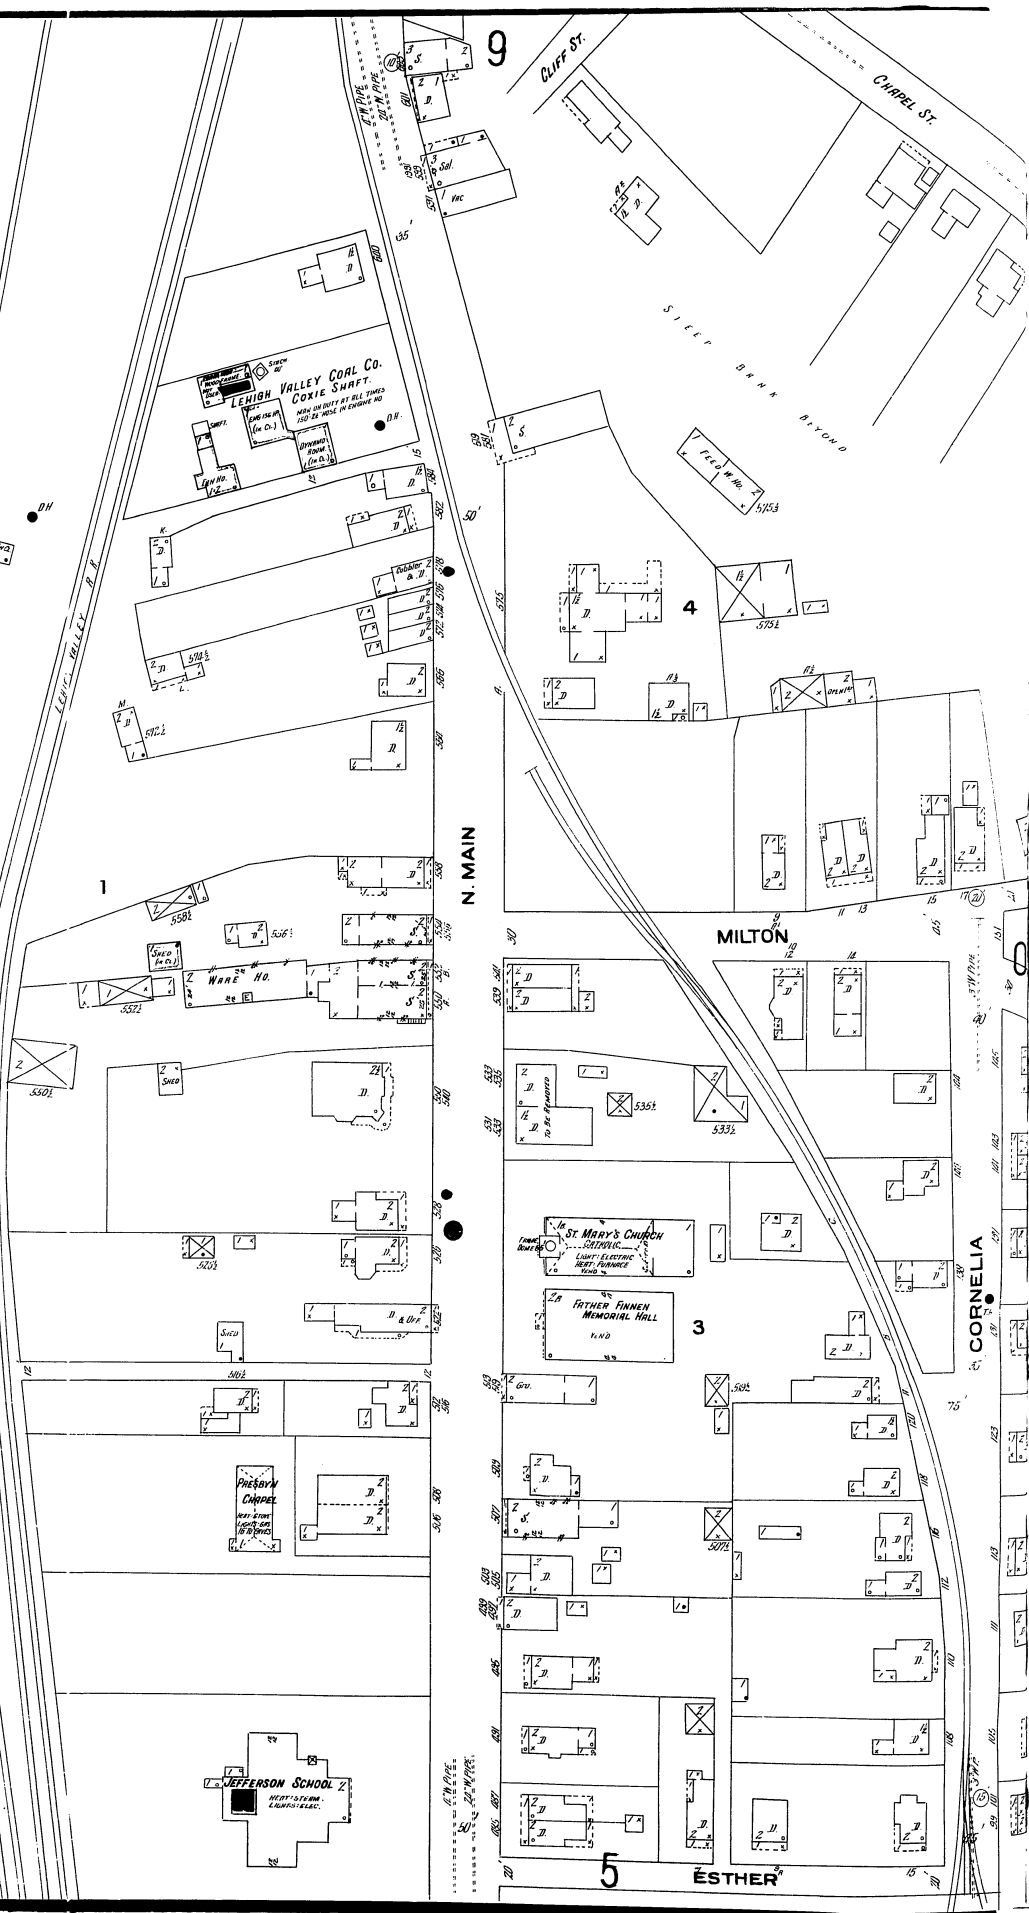

2" FIRE
PIPE
50' - 60' W.P.P.

ESTHER